

Weekly Project Update

Project: Little McDonald
Outlet to Otter Tail River
Location: Otter Tail County, MN

Client: LMKP LID

Moore Engineering Project No.: 18632A

Week End Date: May 5, 2018

Project Field Contact: Ben Skaaland
(218) 396-0593
Lyle Hansen
(218) 849-1055

This field report shows observations while on the construction site.

Little McDonald

Lake Outlet Project

Part A & B

General Contractor Part A :

Geislinger and Sons, Inc.

Subcontractors:

Ackling Construction
Northern Dewatering, Inc.

General Contractor Part B :

Sellin Brothers, Inc

Subcontractors:

Northern Dewatering, Inc.
Jim Ramsey Tree Service
Andy Francis Construction
Robert R. Schroeder Construction
3D Specialties
Sherbrooke Turf

Report Distribution

LMKP LID
Otter Tail County

Reporting Period

April 28, 2018 – May 5, 2018



Figure 1: 3rd Stage Sheet Piling

Summary of Work Performed by Contractor:

- Sellin Bros. installed 24" forcemain pipe.
 - Monday - 720 feet pipe installed.
 - Tuesday - 506 feet installed.
 - Wednesday - 700 feet installed.
 - Thursday - 600 feet installed.
 - Friday - 600 feet installed.
 - Total length of pipe installed this week = 3,126 feet
- Sellin Bros. installed 11 fittings and 3 air release manholes
- Removed 131 square yards of bituminous
- Installed 1,826 linear feet of silt fence
 - 50 linear feet of silt curtain was also installed
- Schroeder completed the third stage of sheeting.
- Completed 410th Avenue with exception of seeding
- Continued to dewater throughout the week.

Challenges and Solutions:

- Encountered another unmarked irrigation line → Coordinating with MVI on repair

Percent of Work Completed:

Part A (Pump Station): 25% of structure complete (based on contract value completed to date). The underground wet well is completed.

Part B (Forcemain): 50% of pipe installed, 100% trees cleared, 0% of intake structure installed

QA/QC Testing/Inspecting Performed and Results:

- Density(soil compaction) tests passed

Upcoming Scheduled Work:

- Sellin Bros. is continuing forcemain, in both directions.
- Sellin Bros. starting 30" intake line and setting intake structure dependent on dewatering.
- Geislinger tentative start on the pump house date is May 14th to accommodate Sellin Bros. construction schedule and dewatering.

Meetings:

- LMKP LID June 6, 2018 3pm
- Construction meeting – none scheduled



Figure 2: Installing Pipe Bend



Figure 4: Installing Forcemain



Figure 3: Installing Pipe Bend



Figure 5: Preparing For Dewatering
and 30" Intake Pipe


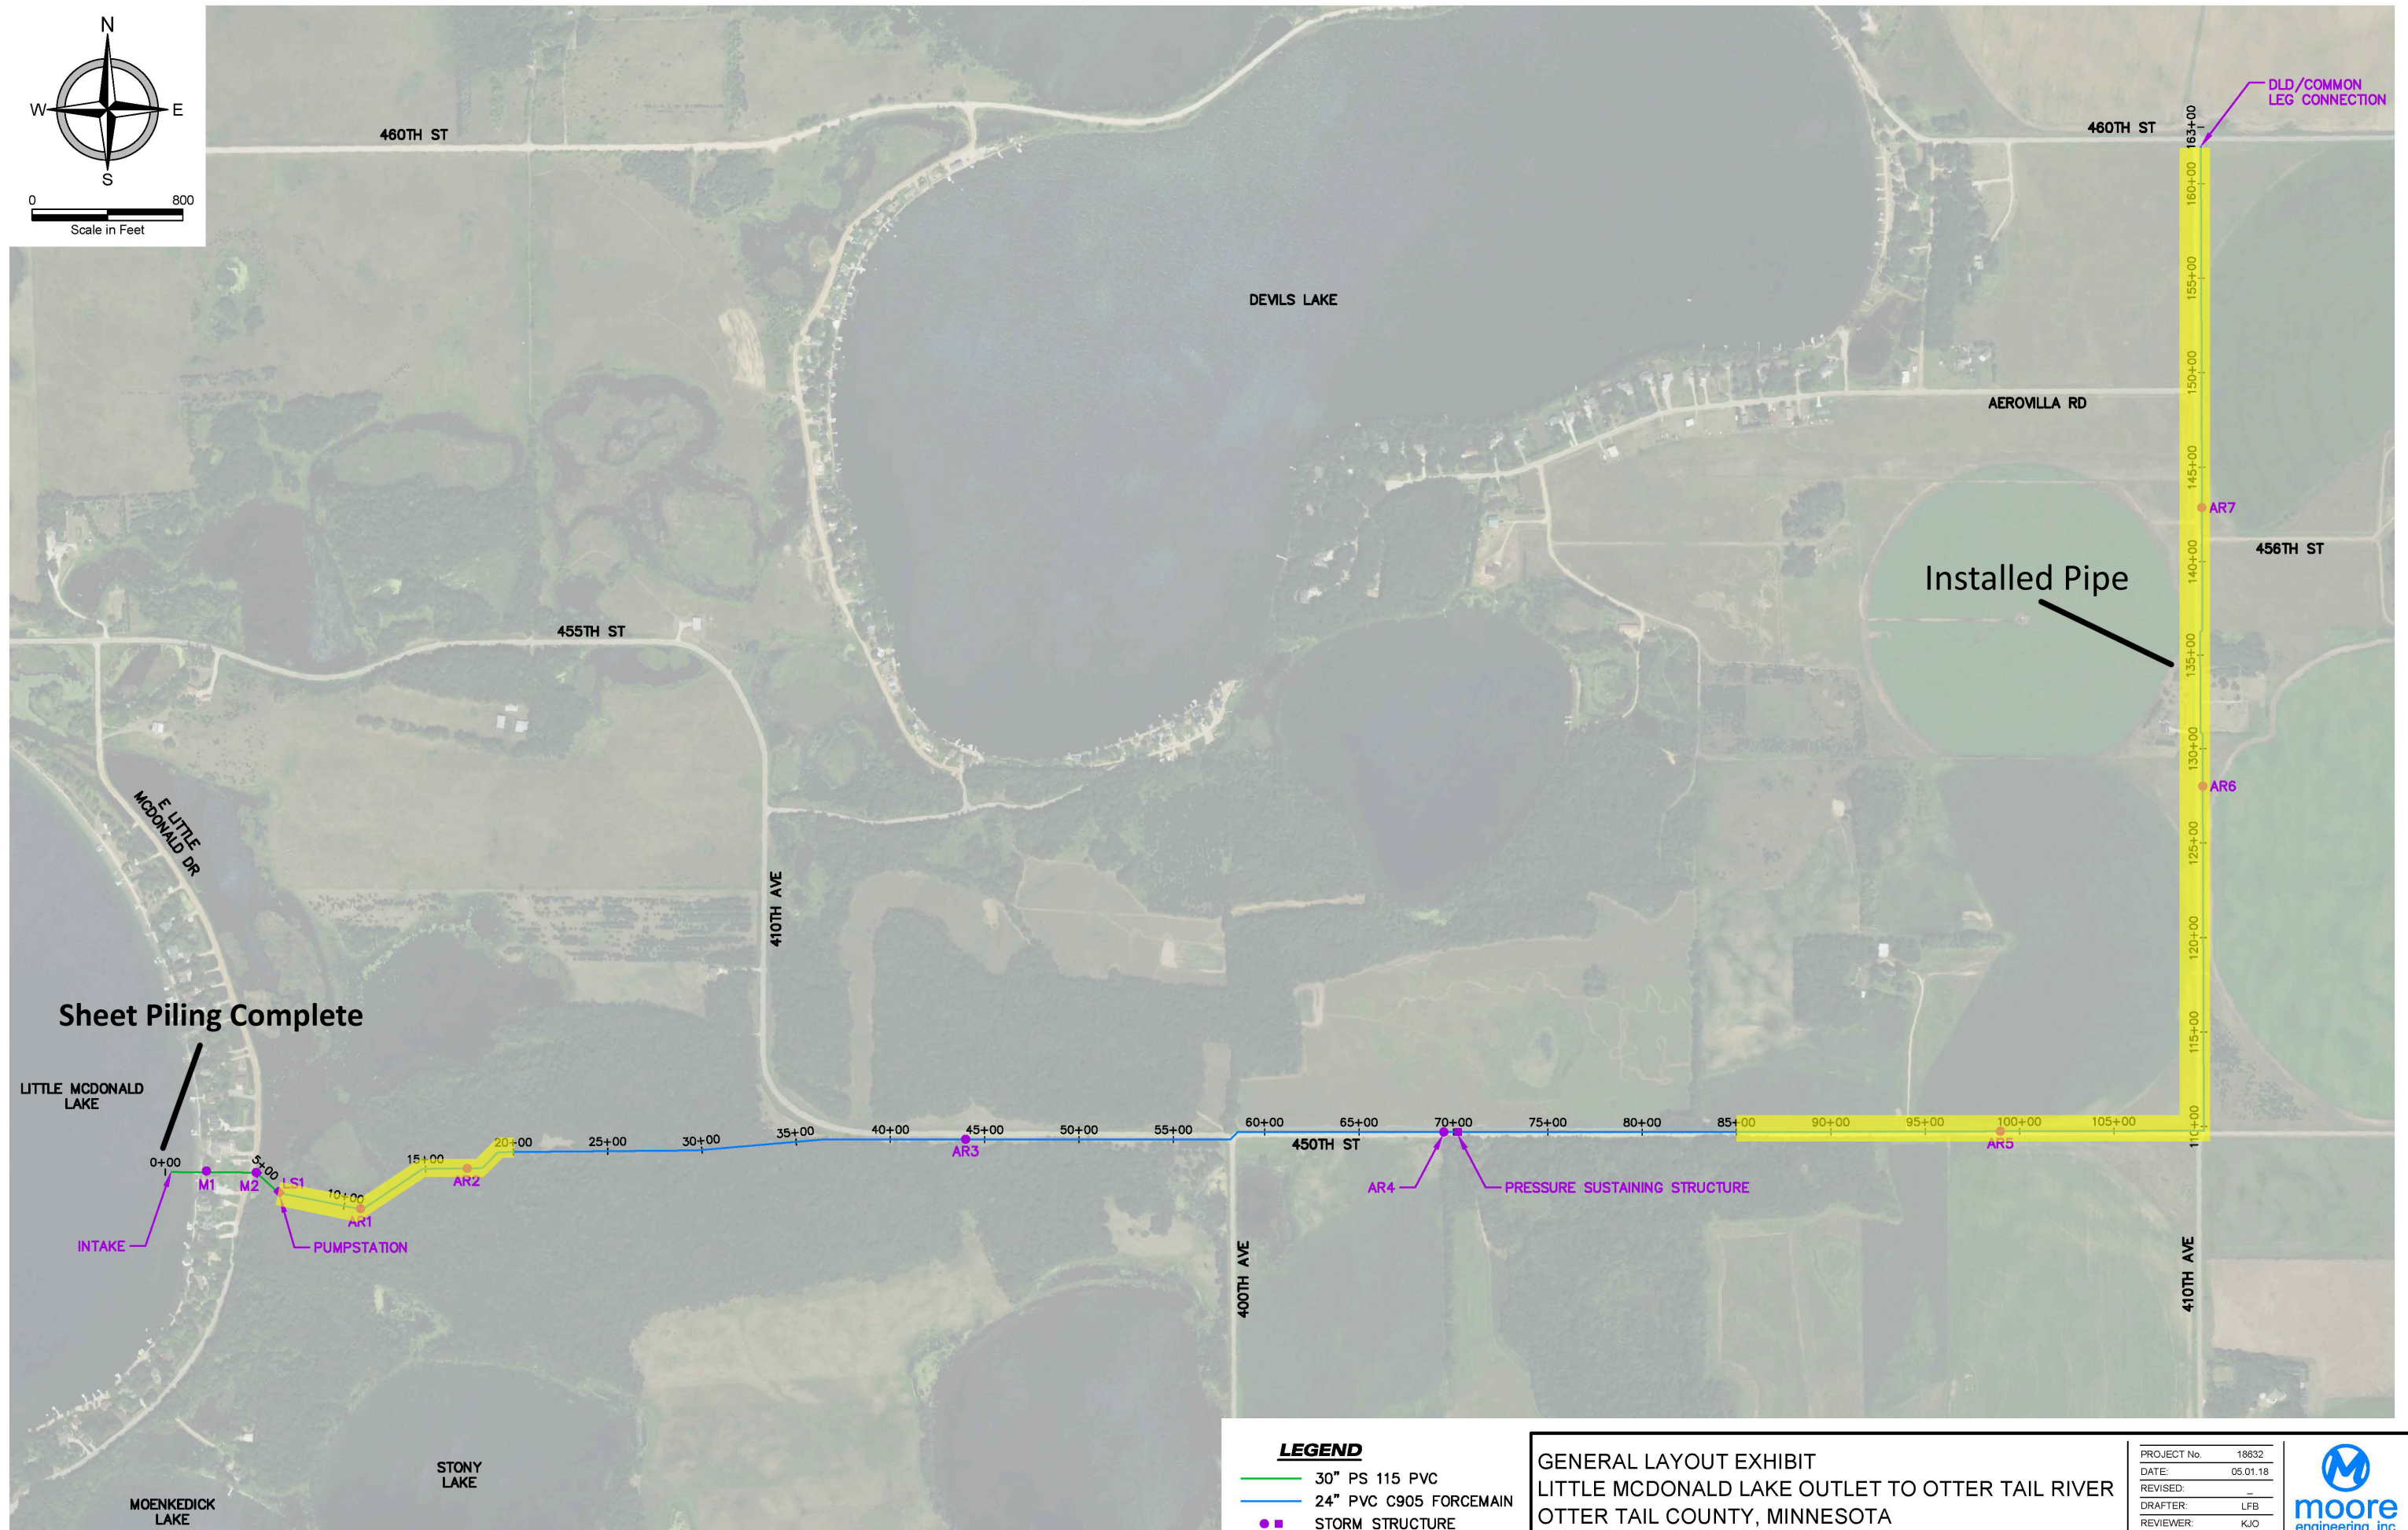


Figure 6: Installing Third Stage Sheet Piling



Figure 7: Insulation on Air Release Manhole

FILE LOCATION: R:\Civil 3D Projects - FFalls\18632 LITTLE MAC OUTLET\DRAWINGS\DESIGN\18632-pp east route.dwg



LEGEND

- 30" PS 115 PVC
- 24" PVC C905 FORCEMAIN
- STORM STRUCTURE

GENERAL LAYOUT EXHIBIT
LITTLE MCDONALD LAKE OUTLET TO OTTER TAIL RIVER
OTTER TAIL COUNTY, MINNESOTA

| | |
|-------------|----------|
| PROJECT No. | 18632 |
| DATE: | 05.01.18 |
| REVISED: | - |
| DRAFTER: | LFB |
| REVIEWER: | KJO |

